

Terminal Protection to IP20




Dims: to DIN 43880
W. 44mm

- Designed to withstand overloads up to 125% (cont.), 150% (10s)
- Microprocessor based
- True R.M.S. monitoring
- Selectable nominal voltages (220, 230, 240, 254, 265, 277V (L>N))
- Monitors own supply and detects an Under voltage condition on one or more phases
- Adjustment for Differential and Under voltage trip level
- Adjustment for Time delay
- DPDT relay output 8A
- Green LED indication for supply status
- Red LED indication for fault/timing status



ISO 9001:2015
Cert. No. 14125771

FUNCTION DIAGRAM

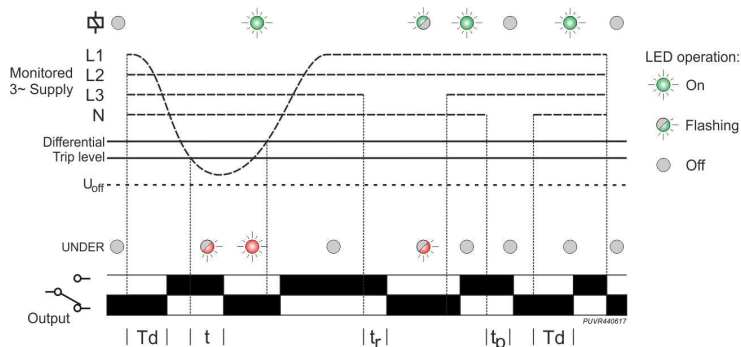

INSTALLATION AND SETTING

Warning: Installation work must be carried out by qualified personnel.

- BEFORE INSTALLATION, ISOLATE THE SUPPLY.
- Connect the unit as required. The Connection Diagram below shows a typical installation, whereby the supply to a load is being monitored by the Phase monitoring relay. If a fault should occur (i.e. fuse blowing), the relay will de-energise and assuming control of the external Contactor, de-energise the Contactor as well.

Setting the unit and applying power.

- Set the "Nominal Voltage (Un)" voltage adjustment to match that of the supply voltage being monitored.
- Set the "Trip Level" and "Differential" adjustments to minimum. Set the "Time Delay" to minimum.
- Apply power and the green "Power supply" LED will illuminate and relay will energise after the short Power on delay (Td). The red "UNDER" LED will remain extinguished.
- Refer to the troubleshooting table if the unit fails to operate correctly.

Setting the unit (with power applied).

- Accurate setting can be achieved by adjusting the "Trip Level" until the unit trips (relay de-energises/red LED lit) then by decreasing the "Trip Level" until the relay re-energises again (red LED extinguished). Close setting of the trip level ensures the unit will detect a phase loss even with a large percentage of re-generative voltage.
- In order to set the unit as previously described but without causing disruption to the equipment being controlled/monitored, set the "Time Delay" to maximum. It will now be possible to establish the trip point when the red LED starts to flash. Decrease the trip level setting to stop the LED flashing. (Note: If the time delay is allowed to expire, the output relay will de-energise)
- If large supply variations are anticipated, the trip level should be set further from the nominal voltage.
- Set the "Delay (t)" as required. (Note that the delay is only effective should the supply drop below the set trip level. However, if during an under voltage condition the supply drops below the fixed "U_{off}" trip level any set time delay is automatically cancelled and the relay de-energises).

Troubleshooting.


The table below shows the status of the unit during a particular fault condition.

Supply fault	Green LED	Red LED	Relay
Under voltage condition (during timing)	On	Flashing	Energised for delay (t)
Under voltage condition (after timing)	On	On	De-energised
Phase missing/below supply threshold (U _{off})	LED's flash alternately		De-energised
Neutral missing	Off	Off	De-energised

TECHNICAL SPECIFICATION


Supply/monitoring voltage Un	220 - 277V AC (L>N)	
(1, 3, 5, 7):	45 - 65Hz	
Frequency range:	132 - 346V AC (L>N)	
Supply variation:	416V for 10s	
Maximum overload (L>N):	III (IEC 60664)	
Overvoltage category:	4kV (1.2/50μs) IEC 60664	
Rated impulse withstand voltage:	3VA/1.7W	
Power consumption (max.):	Under voltage	
Monitoring mode:	Trip levels:	
	Supply threshold (U _{off}):	140V ± 2% (fixed)
	Under:	70 - 100% of Un
Measuring ranges:	Nominal (Un)	Under
	220V	154 - 220V
	230V	161 - 230V
	240V	168 - 240V
	254V	178 - 254V
	265V	185 - 265V
	277V	194 - 277V
Differential:	1 - 15% of Un	
Setting accuracy:	± 3%	
Repeat accuracy:	± 0.5% at constant conditions	
Immunity from micro power cuts:	<50ms	
Delay from Phase loss (t _i):	<300ms (150ms typical)	
Delay from Neutral loss (t _n):	<300ms (150ms typical)	
Delay to relay re-energising:	<500ms (after fault clearing)	
Time delay (t):	0.5 - 10s (± 5%)	
Power on delay (Td):	= 0.5s (worst case = Td x 2)	
Reset time:	50 - 100ms	
Power on indication:	Green LED	
Fault/timing status indication:	Red LED	
Ambient temperature:	-20 to +60°C	
Relative humidity:	+95% max.	
Output (8, 9, 10 / 12, 13, 14):	DPDT relay	
Output rating:	AC1	250V 8A (2000VA)
	AC15	250V 3A
	DC1	25V 8A (200W)
Electrical life:	≥ 150,000 ops at rated load	
Dielectric voltage:	2kV AC (rms) IEC 60947-1	
Rated impulse withstand voltage:	4kV (1.2/50μs) IEC 60664	
Housing:	Grey flame retardant Lexan UL94 V0	
Weight:	100g	
Mounting option:	On to 35mm symmetric DIN rail to BS EN 60715	
Terminal conductor size:	≤ 2 x 2.5mm ² solid or stranded	
Approvals:	Conforms to IEC, CE, and RoHS Compliant. EMC: Immunity: EN 61000-6-2 Emissions: EN 61000-6-4	

CONNECTION DIAGRAM

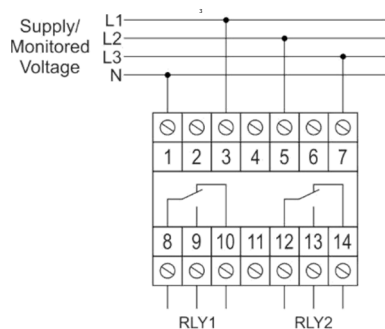

SETTING DETAILS

1. Power supply status (Green) LED
 2. Fault / Timing status (Red) LED
 3. "Nominal Voltage (Un)" selector
 4. "Time Delay (s)" adjustment
 5. "Trip Level (% x Un)" adjustment*
 6. "Differential (% x Un)" adjustment*
- *scaled as % of the selected "Nominal Voltage"

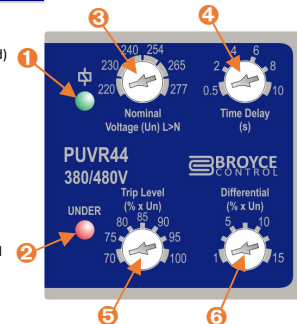

DIMENSIONS

